



ENGINEERING CLARIFICATION

EC TITLE: Specification Section 01 61 00, Common Product Requirements

PROJECT: 3 Kings Water Treatment Plant

EC NO.: 9

DATE: 3/25/2020

STATUS: Acknowledged

SECTION 1: BY CONTRACTOR

QUESTION:

Specification references design requirements that are superceded by Construction Drawings.

DRAWING NO.:

SPECIFICATION SECTION: 01 61 00 Common Product Requirements

POTENTIAL COST IMPACT:

POTENTIAL SCHEDULE IMPACT:

PROPOSED SOLUTION:

Revise specification as shown in the attached.

COMMENTS:

INITIATOR: Zalla, Joseph/SLC

PRIORITY: Normal

REQUESTED RESPONSE DATE: 4/8/2020

SECTION 2: BY REVIEWER

RESPONSE:

COMMENTS:

REVIEWED BY: Sam Conant

REVIEWED DATE: 4/14/2020

**SECTION 01 61 00
COMMON PRODUCT REQUIREMENTS**

PART 1 GENERAL

1.01 DEFINITIONS

A. Products:

1. New items for incorporation in the Work, whether purchased by Contractor or Owner for the Project, or taken from previously purchased stock, and may also include existing materials or components required for reuse.
2. Includes the terms material, equipment, machinery, components, subsystem, system, hardware, software, and terms of similar intent and is not intended to change meaning of such other terms used in Contract Documents, as those terms are self-explanatory and have well recognized meanings in construction industry.
3. Items identified by manufacturer's product name, including make or model designation, indicated in manufacturer's published product literature, that is current as of the date of the Contract Documents.


1.02 DESIGN REQUIREMENTS

EC #9

- A. Where Contractor design is specified, design of installation, systems, equipment, and components, including supports and anchorage, shall be in accordance with provisions of latest edition of 2018 International Building Code (IBC) by International Code Council.

B. Design loads shall be in accordance with the General Structural Notes on the Drawings. For additional requirements see Specifications 01 45 36 Equipment Seismic Certification and 01 88 15 Anchorage and Bracing.

- ~~B. Risk Category: III.~~
- ~~C. Wind: Basic wind speed, 120 mph, with exposure category C, and an importance factor, I, of 1.0.~~
- ~~D. Snow Load: Basic ground snow load p_g 147 psf, exposure coefficient (C_e) of 1.0, thermal factor (C_t) varies, and an importance factor, I_s , of 1.10.~~
- ~~E. Seismic:~~
- ~~1. Importance Factor (I_e), of 1.25.~~
 - ~~2. Site Class: C.~~
 - ~~3. Seismic Design Category: D.~~
 - ~~4. Mapped Spectral Response Accelerations:~~
 - ~~a. $S_s = 0.650g$.~~
 - ~~b. $S_1 = 0.0218g$.~~

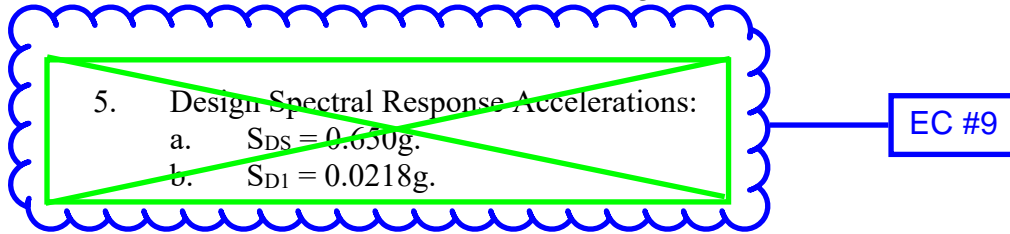

1.03 ENVIRONMENTAL REQUIREMENTS

- A. Altitude: Provide materials and equipment suitable for installation and operation under rated conditions at 6,900 feet above sea level.
- B. Provide equipment and devices installed outdoors or in unheated enclosures capable of continuous operation within an ambient temperature range of minus 30 degrees F to 94.6 degrees F.
- C. Provide equipment and devices installed indoors or in heated enclosures capable of continuous operation within an ambient temperature range of 35 degrees F to 104 degrees F.

1.04 PREPARATION FOR SHIPMENT

- A. When practical, factory assemble products. Mark or tag separate parts and assemblies to facilitate field assembly. Cover machined and unpainted parts that may be damaged by the elements with strippable protective coating.
- B. Package products to facilitate handling and protect from damage during shipping, handling, and storage. Mark or tag outside of each package or crate to indicate its purchase order number, bill of lading number, contents by name, name of Project and Contractor, equipment number, and approximate weight. Include complete packing list and bill of materials with each shipment.
- C. Extra Materials, Special Tools, Test Equipment, and Expendables:
 - 1. Furnish as required by individual Specifications.
 - 2. Schedule:
 - a. Ensure that shipment and delivery occurs concurrent with shipment of associated equipment.
 - b. Transfer to Owner shall occur immediately subsequent to Contractor's acceptance of equipment from Supplier.
 - 3. Packaging and Shipment:
 - a. Package and ship extra materials and special tools to avoid damage during long term storage in original cartons insofar as possible, or in appropriately sized, hinged-cover, wood, plastic, or metal box.

- b. Prominently displayed on each package, the following:
 - 1) Manufacturer's part nomenclature and number, consistent with Operation and Maintenance Manual identification system.
 - 2) Applicable equipment description.
 - 3) Quantity of parts in package.
 - 4) Equipment manufacturer.
- 4. Deliver materials to Site.
- 5. Replace extra materials and special tools found to be damaged or otherwise inoperable at time of transfer to Owner.
- D. Request a minimum 7-day advance notice of shipment from manufacturer.
- E. Factory Test Results: Reviewed and accepted by Engineer before product shipment as required in individual Specification sections.

1.05 DELIVERY AND INSPECTION

- A. Deliver products in accordance with accepted current Progress Schedule and coordinate to avoid conflict with the Work and conditions at Site. Deliver anchor bolts and templates sufficiently early to permit setting prior to placement of structural concrete.
- B. Deliver products in undamaged condition, in manufacturer's original container or packaging, with identifying labels intact and legible. Include on label, date of manufacture and shelf life, where applicable.
- C. Unload products in accordance with manufacturer's instructions for unloading or as specified. Record receipt of products at Site. Promptly inspect for completeness and evidence of damage during shipment.
- D. Remove damaged products from Site and expedite delivery of identical new undamaged products, and remedy incomplete or lost products to provide that specified, so as not to delay progress of the Work.

1.06 HANDLING, STORAGE, AND PROTECTION

- A. Handle and store products in accordance with manufacturer's written instructions and in a manner to prevent damage. Store in approved storage yards or sheds provided by the Contractor. Provide manufacturer's recommended maintenance during storage, installation, and until products are accepted for use by Owner.
- B. Manufacturer's instructions for material requiring special handling, storage, or protection shall be provided prior to delivery of material.

- C. Arrange storage in a manner to provide easy access for inspection. Make periodic inspections of stored products to ensure that products are maintained under specified conditions, and free from damage or deterioration. Keep running account of products in storage to facilitate inspection and to estimate progress payments for products delivered, but not installed in the Work.
- D. Store electrical, instrumentation, and control products, and equipment with bearings in weather-tight structures maintained above 60 degrees F. Protect electrical, instrumentation, and control products, and insulate against moisture, water, and dust damage. Connect and operate continuously space heaters furnished in electrical equipment.
- E. Store fabricated products above ground on blocking or skids, and prevent soiling or staining. Store loose granular materials in well-drained area on solid surface to prevent mixing with foreign matter. Cover products that are subject to deterioration with impervious sheet coverings; provide adequate ventilation to avoid condensation.
- F. Store finished products that are ready for installation in dry and well-ventilated areas. Do not subject to extreme changes in temperature or humidity.
- G. After installation, provide coverings to protect products from damage due to traffic and construction operations. Remove coverings when no longer needed.
- H. Hazardous Materials: Prevent contamination of personnel, storage area, and Site. Meet requirements of product specification, codes, and manufacturer's instructions.

PART 2 PRODUCTS

2.01 GENERAL

- A. Provide manufacturer's standard materials suitable for service conditions, unless otherwise specified in the individual Specifications.
- B. Where product specifications include a named manufacturer, with or without model number, and also include performance requirements, named manufacturer's products must meet the performance specifications.
- C. Like items of products furnished and installed in the Work shall be end products of one manufacturer and of the same series or family of models to achieve standardization for appearance, operation and maintenance, spare parts and replacement, manufacturer's services, and implement same or

similar process instrumentation and control functions in same or similar manner.

- D. Do not use materials and equipment removed from existing premises, except as specifically permitted by Contract Documents.
- E. Provide interchangeable components of the same manufacturer, for similar components, unless otherwise specified.
- F. Equipment, Components, Systems, and Subsystems: Design and manufacture with due regard for health and safety of operation, maintenance, and accessibility, durability of parts, and shall comply with applicable OSHA, state, and local health and safety regulations.
- G. Regulatory Requirement: Coating materials shall meet federal, state, and local requirements limiting the emission of volatile organic compounds and for worker exposure.
- H. Safety Guards: Provide for all belt or chain drives, fan blades, couplings, or other moving or rotary parts. Cover rotating part on all sides. Design for easy installation and removal. Use 16-gauge or heavier; galvanized steel, aluminum coated steel, or galvanized or aluminum coated 1/2-inch mesh expanded steel. Provide galvanized steel accessories and supports, including bolts. For outdoors application, prevent entrance of rain and dripping water.
- I. Authority Having Jurisdiction (AHJ):
 - 1. Provide the Work in accordance with NFPA 70, National Electrical Code (NEC). Where required by the AHJ, material and equipment shall be labeled or listed by a nationally recognized testing laboratory or other organization acceptable to the AHJ in order to provide a basis for approval under NEC.
 - 2. Materials and equipment manufactured within the scope of standards published by Underwriters Laboratories, Inc. shall conform to those standards and shall have an applied UL listing mark.
- J. Equipment Finish:
 - 1. Provide manufacturer's standard finish and color, except where specific color is indicated.
 - 2. If manufacturer has no standard color, provide equipment with finish as approved by Owner or Engineer.
- K. Special Tools and Accessories: Furnish to Owner, upon acceptance of equipment, all accessories required to place each item of equipment in full

operation. These accessory items include, but are not limited to, adequate oil and grease (as required for first lubrication of equipment after field testing), light bulbs, fuses, hydrant wrenches, valve keys, handwheels, chain operators, special tools, and other spare parts as required for maintenance.

- L. Lubricant: Provide initial lubricant recommended by equipment manufacturer in sufficient quantity to fill lubricant reservoirs and to replace consumption during testing, startup, and operation until final acceptance by Owner. Maintain a full and complete record of lubrication and other maintenance activities completed until the time of final acceptance.
- M. Components and Materials in Contact with Water for Human Consumption: Comply with the requirements of the Safe Drinking Water Act and other applicable federal, state, and local requirements. Provide certification by manufacturer or an accredited certification organization recognized by the Authority Having Jurisdiction that components and materials comply with the maximum lead content standard in accordance with NSF/ANSI 61 and NSF/ANSI 372.
 - 1. Use or reuse of components and materials without a traceable certification is prohibited.
- N. Equipment "Made in U.S.A." is preferred in accordance with the following definition:
 - 1. Made in the USA: Based on standards set forth in the Federal Trade Commission's (FTC) "Made in the USA" policy. The United States includes the 50 states, the District of Columbia, and the U.S. territories and possessions. The standard requires that "all significant parts and processing that go into the product must be of U.S. origin. That is, the product should contain no - or negligible - foreign content." The product's final assembly or processing must take place in the United States. Other factors considered, include how much of the product's total manufacturing costs can be assigned to U.S. parts and processing and how far removed any foreign content is from the finished product. In some instances, only a small portion of the total manufacturing costs are attributable to foreign processing, but that processing represents a significant amount of the product's overall processing. The same can be true for some foreign parts.
 - 2. Any exceptions to this requirement shall be specifically stated and identified in the proposal.

3KINGS WTP PHASE III DESIGN

2.02 FABRICATION AND MANUFACTURE

A. General:

1. Manufacture parts to U.S.A. standard sizes and gauges.
2. Two or more items of the same type shall be identical, by the same manufacturer, and interchangeable.
3. Design structural members for anticipated shock and vibratory loads.
4. Use 1/4-inch minimum thickness for steel that will be submerged, wholly or partially, during normal operation.
5. Modify standard products as necessary to meet performance Specifications.

B. Lubrication System:

1. Require no more than weekly attention during continuous operation.
2. Convenient and accessible; oil drains with bronze or stainless steel valves and fill-plugs easily accessible from the normal operating area or platform. Locate drains to allow convenient collection of oil during oil changes without removing equipment from its installed position.
3. Provide constant-level oilers or oil level indicators for oil lubrication systems.
4. For grease type bearings, which are not easily accessible, provide and install stainless steel tubing; protect and extend tubing to convenient location with suitable grease fitting.

2.03 SOURCE QUALITY CONTROL

- A. Where Specifications call for factory testing to be witnessed by Engineer, notify Owner and Engineer not less than 14 days prior to scheduled test date, unless otherwise specified.
- B. Calibration Instruments: Bear the seal of a reputable laboratory certifying instrument has been calibrated within the previous 12 months to a standard endorsed by the National Institute of Standards and Technology (NIST).
- C. Factory Tests: Perform in accordance with accepted test procedures and document successful completion.

PART 3 EXECUTION

3.01 INSPECTION

- A. Inspect materials and equipment for signs of pitting, rust decay, or other deleterious effects of storage. Do not install material or equipment showing such effects. Remove damaged material or equipment from the Site and

expedite delivery of identical new material or equipment. Delays to the Work resulting from material or equipment damage that necessitates procurement of new products will be considered delays within Contractor's control.

3.02 MANUFACTURER'S CERTIFICATE OF COMPLIANCE

- A. When so specified, a Manufacturer's Certificate of Compliance, a copy of which is attached to this section, shall be completed in full, signed by entity supplying the product, material, or service, and submitted prior to shipment of product or material or execution of the services.
- B. Engineer may permit use of certain materials or assemblies prior to sampling and testing if accompanied by accepted certification of compliance.
- C. Such form shall certify proposed product, material, or service complies with that specified. Attach supporting reference data, affidavits, and certifications as appropriate.
- D. May reflect recent or previous test results on material or product, if acceptable to Engineer.

3.03 INSTALLATION

- A. Equipment Drawings show general locations of equipment, devices, and raceway, unless specifically dimensioned.
- B. No shimming between machined surfaces is allowed.
- C. Install the Work in accordance with NECA Standard of Installation, unless otherwise specified.
- D. Repaint painted surfaces that are damaged prior to equipment acceptance.
- E. Do not cut or notch any structural member or building surface without specific approval of Engineer.
- F. Handle, install, connect, clean, condition, and adjust products in accordance with manufacturer's instructions, and as may be specified. Retain a copy of manufacturers' instruction at Site, available for review at all times.
- G. For material and equipment specifically indicated or specified to be reused in the Work:
 - 1. Use special care in removal, handling, storage, and reinstallation to assure proper function in the completed Work.

3KINGS WTP PHASE III DESIGN

2. Arrange for transportation, storage, and handling of products that require offsite storage, restoration, or renovation. Include costs for such Work in the Contract Price.

3.04 FIELD FINISHING

- A. In accordance with Section 09 90 00, Painting and Coating, and individual Specification sections.

3.05 ADJUSTMENT AND CLEANING

- A. Perform required adjustments, tests, operation checks, and other startup activities.

3.06 LUBRICANTS

- A. Fill lubricant reservoirs and replace consumption during testing, startup, and operation prior to acceptance of equipment by Owner.

3.07 SUPPLEMENTS

- A. The supplement listed below, following “End of Section”, is part of this specification.
 1. Form: Manufacturer’s Certificate of Compliance.

END OF SECTION

MANUFACTURER'S CERTIFICATE OF COMPLIANCE

OWNER: _____ PRODUCT, MATERIAL, OR SERVICE
PROJECT NAME: _____ SUBMITTED: _____
PROJECT NO: _____

Comments: _____

I hereby certify that the above-referenced product, material, or service called for by the Contract for the named Project will be furnished in accordance with all applicable requirements. I further certify that the product, material, or service are of the quality specified and conform in all respects with the Contract requirements, and are in the quantity shown.

Date of Execution: _____, 20__

Manufacturer: _____

Manufacturer's Authorized Representative (*print*): _____

(Authorized Signature)

