



ENGINEERING CLARIFICATION

EC TITLE: Standard Detail 2242-120 Clarification
PROJECT: 3 Kings Water Treatment Plant

EC NO.: 100
DATE: 3/4/2021
STATUS: Open

SECTION 1: BY CONTRACTOR

QUESTION:

This clarification provides missing Standard Detail 2242-120.

DRAWING NO.:
SPECIFICATION SECTION:

POTENTIAL COST IMPACT:
POTENTIAL SCHEDULE IMPACT:

PROPOSED SOLUTION:

See attached Standard Detail 2242-120.

COMMENTS:

INITIATOR: Scott Hoffman

PRIORITY: Normal
REQUESTED RESPONSE DATE: 3/18/2021


SECTION 2: BY REVIEWER

RESPONSE:

COMMENTS:

REVIEWED BY:

REVIEWED DATE:

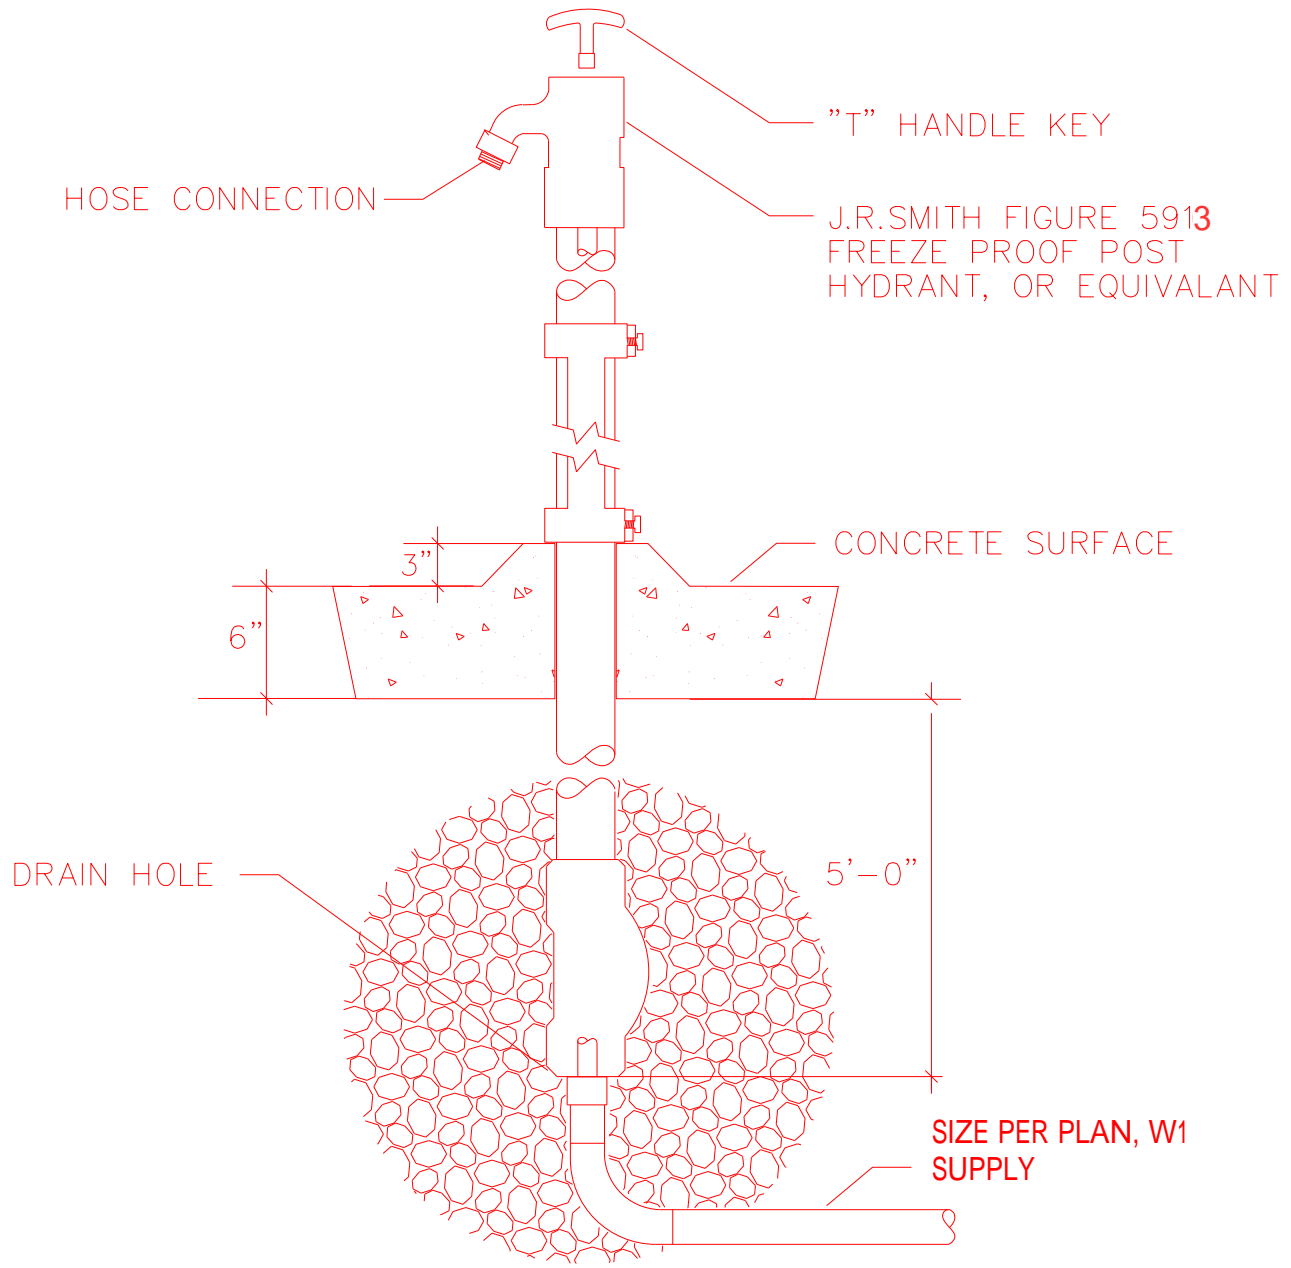

YARD HYDRANT

NTS

EC#100

3Kings WTP Phase III Design
Park City Municipal Corporation
Park City, Utah

2242-120